

# DIFFERENTIAL PRESSURE (FLOW) TRANSMITTER

## DATA SHEET

FKC...5

The FCX-AIII differential pressure (flow) transmitter accurately measures differential pressure, liquid level, gauge pressure or flow rate and transmits a proportional 4 to 20mA signal. The transmitter utilizes a unique micromachined capacitance silicon sensor with state-of-the-art microprocessor technology to provide exceptional performance and functionality.



## FEATURES

- High accuracy up to  $\pm 0.04\%$**   
0.065% accuracy as standard, 0.04% accuracy as option.  
Fuji's micro-capacitance silicon sensor assures this accuracy for all elevated or suppressed calibration ranges without additional adjustment.
- Minimum environmental influence**  
The "Advanced Floating Cell" design which protects the pressure sensor against changes in temperature, static pressure, and overpressure substantially reduces total measurement error in actual field applications.
- Fuji/HART® bilingual communications protocol and FOUNDATION™ fieldbus and Profibus™ compatibility**  
FCX-AIII series transmitter offers bilingual communications to speak both Fuji proprietary protocol and HART®. Any HART® compatible devices can communicate with FCX-AIII. Further, by upgrading electronics FOUNDATION™ fieldbus and Profibus™ are also available.
- Application flexibility**  
Various options that render the FCX-AIII suitable for almost any process applications include.
  - Full range of hazardous area approvals
  - Built-in RFI filter and lightning arrester
  - 5-digit LCD meter with engineering unit
  - Stainless steel electronics housing
  - Wide selection of materials
- Programmable output Linearization Function**  
In addition to Linear and Square Root, output signal can be freely programmable.  
(Up to 14 compensated points at approximation.)
- Burnout current flexibility (Under Scale: 3.2 to 4.0mA, Over Scale: 20.0 to 21.6mA)**  
Burnout signal level is adjustable using Model FXW Hand Held Communicator (HHC) to comply with NAMUR NE43.
- Dry calibration without reference pressure**  
Thanks to the best combination of unique construction of mechanical parts (Sensor unit) and high performance electronics circuit (Electronics unit), reliability of dry calibration without reference pressure is at equal level as wet calibration.

## SPECIFICATIONS

### Functional specifications

**Service:** Liquid, gas, or vapour  
**Static pressure, span, and range limit:**

Type	Static pressure [MPa] {bar}	Span limit [kPa] {m bar}		Range limit [kPa] {m bar}
		Min.	Max.	
FKC□11	-0.1 to + 0.2 { -1 to + 2 }	0.1 { 1 }	1 { 10 }	+/- 1 { +/- 10 }
FKC□12	-0.1 to + 10 { -1 to + 100 }	0.1 { 1 }	6 { 60 }	+/- 6 { +/- 60 }
FKC□23	-0.1 to + 10 { -1 to + 100 }	0.32 { 3.2 }	32 { 320 }	+/- 32 { +/- 320 }
FKC□25	-0.1 to + 10 { -1 to + 100 }	1.3 { 13 }	130 { 1300 }	+/- 130 { +/- 1300 }
FKC□26	-0.1 to + 10 { -1 to + 100 }	5 { 50 }	500 { 5000 }	+/- 500 { +/- 5000 }
FKC□33	-0.1 to + 16 { -1 to + 160 }	0.32 { 3.2 }	32 { 320 }	+/- 32 { +/- 320 }
FKC□35	-0.1 to + 16 { -1 to + 160 }	1.3 { 13 }	130 { 1300 }	+/- 130 { +/- 1300 }
FKC□36	-0.1 to + 16 { -1 to + 160 }	5 { 50 }	500 { 5000 }	+/- 500 { +/- 5000 }
FKC□38	-0.1 to + 16 { -1 to + 160 }	30 { 300 }	3000 { 30000 }	+/- 3000 { +/- 30000 }
FKC□43	-0.1 to + 42 { -1 to + 420 }	0.32 { 3.2 }	32 { 320 }	+/- 32 { +/- 320 }
FKC□45	-0.1 to + 42 { -1 to + 420 }	1.3 { 13 }	130 { 1300 }	+/- 130 { +/- 1300 }
FKC□46	-0.1 to + 42 { -1 to + 420 }	5 { 50 }	500 { 5000 }	+/- 500 { +/- 5000 }
FKC□48	-0.1 to + 30 { -1 to + 300 }	30 { 300 }	3000 { 30000 }	+/- 3000 { +/- 30000 }
FKC□49	-0.1 to + 30 { -1 to + 300 }	500 { 5000 }	20000 { 200000 }	+/- 5000 { +/- 200000 }


Remark : To minimize environmental influence, span should be greater than 1/40 of the max. span in most applications.

- Lower limit of static pressure (vacuum limit) ;  
Silicone fill sensor: See Fig. 1  
Fluorinated fill sensor: 66kPa abs (500mmHg abs) at temperature below 60°C
- The maximum span of each sensor can be converted to different units using factors as below.  
 $1\text{MPa} = 10^3\text{KPa} = 10\text{bar} = 10.19716\text{kgf/cm}^2 = 145.0377\text{psi}$   
 $1\text{kPa} = 10\text{mbar} = 101.9716\text{mmH}_2\text{O} = 4.01463\text{inH}_2\text{O}$

**Over range limit:** To maximum static pressure limit  
**Output signal:** 4 to 20mA DC (linear or square root) with digital signal superimposed on the 4 to 20mA signal

**Power supply:** Transmitter operates on 10.5V to 45V DC at transmitter terminals.  
 10.5V to 32V DC for the units with optional arrester.

**Load limitations:** see figure below

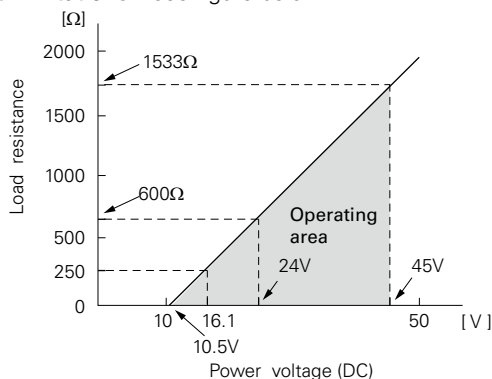

Note: For communication with HHC<sup>(1)</sup> (Model: FXW), min. of 250 Ω required.

**Hazardous locations: (Under an application) SEE TABLE2**

**Zero/span adjustment:**

Zero and span are adjustable from the HHC<sup>(1)</sup>. Zero and span are also adjustable externally from the adjustment screw (span adjustment is not available with 9th digit code "L, P, M, Q, S, N").

**Damping:** Adjustable from HHC or local configurator unit with LCD display.  
 The time constant is adjustable between 0.06 to 32 seconds.

**Zero elevation/suppression:**

–100% to +100% of URL

**Normal/reverse action:**

Selectable from HHC<sup>(1)</sup>

**Indication:** Analog indicator or 5-digit LCD meter, as specified.

**Burnout direction:** Selectable from HHC<sup>(1)</sup>

If self-diagnostic detect transmitter failure, the analog signal will be driven to either "Output Hold", "Output Overscale" or "Output Underscale" modes.

"Output Hold":


Output signal is hold as the value just before failure happens.

"Output Overscale":

Adjustable within the range 20.0mA to 21.6mA from HHC<sup>(1)</sup>

"Output Underscale":

Adjustable within the range 3.2mA to 4.0mA from HHC<sup>(1)</sup>

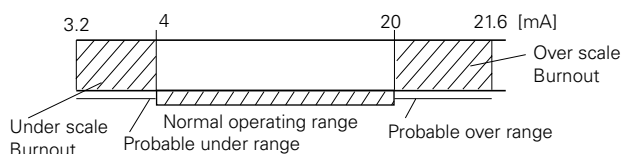

Output limits conforming to NAMUR NE43 by order.

**Loop-check output:**

Transmitter can be configured to provide constant signal 3.2mA through 21.6mA by HHC<sup>(1)</sup>.

**Temperature limit:**

Ambient: –40 to +85°C

(–20 to +80°C for LCD indicator)

(–40 to +60°C for arrester option)

(–10 to +60°C for fluorinated oil filled transmitters)

For explosionproof units (flameproof or intrinsic safety), ambient temperature must be within the limits specified in each standard.

Process: –40 to +120°C for silicone fill sensor

–20 to +80°C for fluorinated oil fill sensor

Storage: –40 to +90°C

**Humidity limit:** 0 to 100% RH

**Communication:** With HHC<sup>(1)</sup> (Model FXW, consult Data Sheet No. EDS8-47), following items can be remotely displayed or configured.

Note: HHC's version must be higher than 7.0 (or FXW □□□□1–□4), for FCX–AIII.

**Local configurator with LCD display (option):**

Local configurator with 3 push button and LCD display can support following items.

Items	By communication with FXW		By local configurator (with 3 push button)	
	Display	Set	Display	Set
Tag No.	✓	✓	✓	✓
Model No.	✓	✓	✓	✓
Serial No. & Software Version	✓	—	✓	—
Engineering unit	✓	✓	✓	✓
Range limit	✓	—	✓	—
Measuring range	✓	✓	✓	✓
Damping	✓	✓	✓	✓
Output mode	Linear	✓	✓	✓
	Square root	✓	✓	✓
Burnout direction	✓	✓	✓	✓
Calibration	✓	✓	✓	✓
Output adjust	—	✓	—	✓
Data	✓	—	✓	—
Self diagnoses	✓	—	✓	—
Printer (In case of FXW with printer option)	✓	—	—	—
External switch lock	✓	✓	✓	✓
Transmitter display	✓	✓	✓	✓
Linearize	✓	✓	—	—
Rerange	✓	✓	✓	✓
Saturate current	✓	✓	✓	✓
Write protect	✓	✓	✓	✓
History	—	✓	—	✓
	—	—	—	—

**Programmable output linearization function:**

Output signal can be characterized with "14 points linear approximation function" from HHC<sup>(1)</sup>.

**EMC Conformity:** EN61326-1: 2006 CE

## Performance specifications for linear output

Reference conditions, silicone oil fill, 316SS isolating diaphragms, 4 to 20mA analog output in linear mode.

**Accuracy rating:** (including linearity, hysteresis, and repeatability)

### Max span 32kPa to 3000kPa model:

For spans greater than 1/10 of URL:

$$\pm 0.065\% \text{ of span or } \pm 0.04\% \text{ of span (21th digit: H)}$$

For spans below 1/10 of URL:

$$\pm \left( 0.015 + 0.05 \frac{0.1 \times \text{URL}}{\text{Span}} \right) \% \text{ of span}$$

### Max span 20MPa model:

For spans greater than 5MPa:  $\pm 0.1\%$  of span

For spans below 5MPa:

$$\pm \left( 0.05 + 0.05 \frac{5\text{MPa}}{\text{Span}} \right) \% \text{ of span}$$

### Max span 1kPa, 6kPa model:

For spans greater than 1/10 of URL:  $\pm 0.1\%$  of span

For spans below 1/10 of URL:

$$\pm \left( 0.05 + 0.05 \frac{0.1 \times \text{URL}}{\text{Span}} \right) \% \text{ of span}$$

**Stability:**  $\pm 0.1\%$  of upper range limit (URL) for 10 years for 6th digit code 3, 5, 6, 8 and 9.

### Temperature effect:

Effects per 28°C change between the limits of -40°C and +85°C

Range code (6th digit in Code symbols)	Zero shift	Total effect
"1"/1kPa {10mbar} "2"/6kPa {60mbar}	$\pm \left( 0.125 + 0.1 \frac{\text{URL}}{\text{Span}} \right) \%$	$\pm \left( 0.15 + 0.1 \frac{\text{URL}}{\text{Span}} \right) \%$
"3"/32kPa {320mbar} "5"/130kPa {1300mbar} "6"/500kPa {5000mbar} "8"/3000kPa {30000mbar} "9"/20000kPa {200000mbar}	$\pm \left( 0.075 + 0.0125 \frac{\text{URL}}{\text{Span}} \right) \%$	$\pm \left( 0.095 + 0.0125 \frac{\text{URL}}{\text{Span}} \right) \%$

### Static pressure effect:

Static pressure code (5th digit in Code symbols)	Zero shift (% of URL)
"1" / 1kPa {10m bar} sensor "2" / 6kPa {60 m bar} sensor	$\pm 0.2\%$ / 0.2MPa {2bar} $\pm 0.2\%$ / 3.2MPa {32bar}
"2" "3" "4"	$\pm 0.035\%$ / 6.9MPa {69bar} $\pm 0.2\%$ / 6.9MPa {69bar} FK□49

### Overrange effect:

Static pressure code (5th digit in Code symbols)	Zero shift (% of URL)
"1" / 1kPa {10m bar} sensor "2" / 6kPa {60m bar} sensor	$\pm 0.3\%$ / 0.2MPa {2bar} $\pm 0.1\%$ / 3.2MPa {32bar}
"2" "3" "4"	$\pm 0.1\%$ / 10MPa {100bar} $\pm 0.1\%$ / 16MPa {160bar} FK□3[5,6,8] $\pm 0.15\%$ / 16MPa {160bar} FK□33 $\pm 0.25\%$ / 42MPa {420 bar} FK□4[3,5,6,8] $\pm 0.2\%$ / 10MPa {100bar} FK□49

## Performance specifications for square root output

### Accuracy rating:

Output	Span	
	over 0.1 × URL	below 0.1 × URL
50 to 100%	$\pm 0.065\%$	$\pm (0.015 + 0.05 \times 0.1 \times \text{URL}/\text{Span})\%$
20 to 50%	$\pm 0.163\%$	$\pm 2.5 \times (0.015 + 0.05 \times 0.1 \times \text{URL}/\text{Span})\%$
10 to 20%	$\pm 0.325\%$	$\pm 5 \times (0.015 + 0.05 \times 0.1 \times \text{URL}/\text{Span})\%$

### Max span 1kPa, 6kPa model:

Output	Accuracy
50 to 100%	$\pm 0.1\%$
20 to 50%	$\pm 0.25\%$
10 to 20%	$\pm 0.5\%$

### Temperature effect:

Effects per 28°C change between the limits of -40°C and +85°C

Range code	Shift at 20% output point
"1" and "2"	$\pm \left( 0.375 + 0.25 \frac{\text{URL}}{\text{Span}} \right) \%/28^\circ\text{C}$
"3" through "9"	$\pm \left( 0.24 + 0.03125 \frac{\text{URL}}{\text{Span}} \right) \%/28^\circ\text{C}$

**Low flow cut-off:** Customer configurable for any point between 0 to 20% of output

## Performance specifications common for both atpt modes

### Supply voltage effect:

Less than 0.005% of calibrated span per 1V

**Update rate:** 60 msec

**Step response:** (without electrical damping)

Range code (6th digit in code symbols)	Time constant (at 23°C)	Dead time
"1"	0.33 s	0.12 s
"2"	0.3 s	
"3"	0.12 s	
"5" through "8"	0.08 s	

### Mounting position effect:

Zero shift, less than 0.12kPa {1.2m bar} for a 10° tilt in any plane.

No effect on span.

This error can be corrected by adjusting Zero.

### Dielectric strength:

500V AC, 50/60Hz 1 min., between circuit and earth.

### Insulation resistance:

More than 100MΩ at 500V DC.

### Internal resistance for external field indicator:

12Ω or less

## Physical specifications

### Electrical connections:

G1/2, 1/2-14 NPT, Pg13.5, or M20 × 1.5 conduit, as specified.

### Process connections:

1/4-18 NPT or Rc1/4 on 54mm centers, as specified.

Meets DIN 19213.

### Process-wetted parts material:

Material code (7th digit in Code symbols)	Process cover	Diaphragm	Wetted sensor body	Vent/drain
V	316 stainless steel(*1)	316L stainless steel	316 stainless steel	316 stainless steel
W	316 stainless steel(*1)	Hastelloy-C	316 stainless steel	316 stainless steel
H	316 stainless steel(*1)	Hastelloy-C	Hastelloy-C lining	316 stainless steel
J	316 stainless steel(*1)	316L stainless steel +Au coating	316 stainless steel	316 stainless steel
M	316 stainless steel(*1)	Monel	Monel lining	316 stainless steel
T	316 stainless steel(*1)	Tantalum	Tantalum lining	316 stainless steel
B	Hastelloy-C lining	Hastelloy-C	Hastelloy-C lining	Hastelloy-C
L	Monel lining	Monel	Monel lining	Monel
U	Tantalum lining	Tantalum	Tantalum lining	Hastelloy-C

Notes: \* (1) ASTM CF8M

Remark: Availability of above material design depends on ranges and static pressure. Refer to "Code symbols".

### Non-wetted parts material:

Electronics housing: Low copper die-cast aluminum alloy finished with polyester coating (standard), or 316 stainless steel (SCS14 per JIS G5121), as specified.

Bolts and nuts: Cr-Mo alloy (standard), 304 or 316 stainless steel (for static pressure code "1", "2", and "3" only), or 630 stainless steel (for static pressure code "3" and "4" only). Static pressure rating for code "3" with 304 and 316 stainless steel bolts is degraded to 10MPa.

Fill fluid: Silicone oil (standard) or fluorinated oil

Mounting bracket: 304 or 316 stainless steel

### Environmental protection:

IEC IP67 and NEMA 6/6P

### Mounting:

On 60.5mm(JIS 50A) pipe using mounting bracket, direct wall mounting, or direct process mounting.

### Mass(weight):

Transmitter approximately 3.1 to 3.6kg without options.

Add; 0.5kg for mounting bracket

4.5kg for stainless steel housing option

## Optional features

### Indicator:

A plug-in analog indicator (2.5% accuracy).

An optional 5-digit LCD meter with engineering unit is also available.

### Local configurator with LCD display:

An optional 5 digits LCD meter with 3 push buttons can support items as using communication with FXW.

### Arrester:

A built-in arrester protects the electronics from lightning surges.

Lightning surge immunity:

4kV (1.2 × 50μs)

### Oxygen service:

Special cleaning procedures are followed throughout the process to maintain all process wetted parts oil-free.

The fill fluid is fluorinated oil.

### Chlorine service:

The fill fluid is fluorinated oil.

### Degreasing:

Process-wetted parts are cleaned, but the fill fluid is standard silicone oil. Not for use on oxygen or chlorine measurement.

### NACE specification:

Metallic materials for all pressure boundary parts comply with NACE MR-01-75. ASTM B7M or L7M bolts and 2HM nuts (Class II) are available.

Static pressure rating for code "3" (16 MPa) is degraded to 10MPa.

### Vacuum service:

Special silicone oil and filling procedure are applied.

See Fig. 1.

**Optional tag plate:** An extra stainless steel tag with customer tag data is wired to the transmitter.

### Coating of cell:

Cell's surface is finished with epoxy/polyurethane double coating. Specify if environment is extremely corrosive.

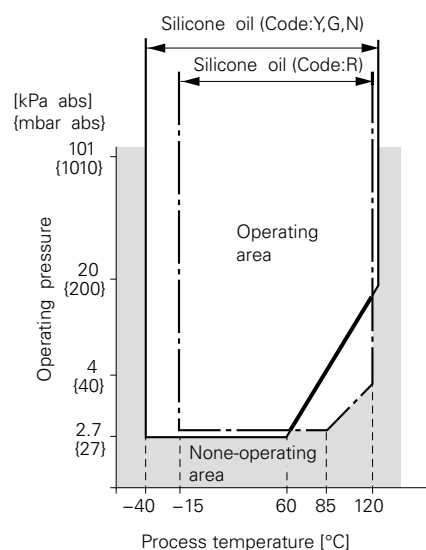


Fig. 1 Relation between process temperature and operating pressure

# CODE SYMBOLS

Digit	Description				Note	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	21	Digit No. of code
4	<Connection>					F	K	C					5									
	Process connection	Oval flange screw	Conduit connection	Case type																		
	Rc1/4	7/16-20UNF	G1/2	T type																		
	1/4-18NPT	7/16-20UNF	1/2-14NPT	T type																		
	1/4-18NPT	M10 (or M12)(*1)	Pg 13.5	T type	Note 1																	
	1/4-18NPT	M10 (or M12)(*1)	M20×1.5	T type	Note 1																	
	1/4-18NPT	7/16-20UNF	Pg 13.5	T type																		
	Rc1/4	7/16-20UNF	G1/2	L type																		
	1/4-18NPT	7/16-20UNF	1/2-14NPT	L type																		
	1/4-18NPT	M10 (or M12)(*1)	Pg 13.5	L type	Note 1																	
	1/4-18NPT	M10 (or M12)(*1)	M20×1.5	L type	Note 1																	
	1/4-18NPT	7/16-20UNF	Pg 13.5	L type																		
5, 6, 7	<Span and materials>																					
	Static pressure [MPa] {bar}	Span limit (*2) [kPa] (m bar)	Process cover	Diaphragm	Wetted cell body	Note 2																
	-0.1 to +0.2 {−1 to +2}	0.1...1 {1...10}	316 stainless steel 316 stainless steel 316 stainless steel	316L stainless steel Hast. C 316L stainless steel +Au coating	316 stainless steel SUS316 316 stainless steel																	
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	11H
	-0.1 to +10 {−1 to 100}	0.1...6 {1...60}	316 stainless steel 316 stainless steel 316 stainless steel	316L stainless steel Hast. C 316L stainless steel +Au coating	316 stainless steel SUS316 316 stainless steel																	22V
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	22W
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	22J
	-0.1 to +16 {−1 to +160}	0.32...32 {3.2...320}	316 stainless steel 316 stainless steel 316 stainless steel	316L stainless steel Hast. C 316L stainless steel +Au coating	316 stainless steel SUS316 316 stainless steel																	22H
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	33V
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	33W
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	33J
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	33H
			316 stainless steel Monel	Monel	Monel lining																	33M
			316 stainless steel Tantalum	Tantalum	Tantalum lining																	33T
		1.3...130 {13...1300}	316 stainless steel 316 stainless steel 316 stainless steel	316L stainless steel Hast. C 316L stainless steel +Au coating	316 stainless steel SUS316 316 stainless steel																	35V
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	35W
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	35J
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	35H
			316 stainless steel Monel	Monel	Monel lining																	35M
			316 stainless steel Tantalum	Tantalum	Tantalum lining																	35T
		5...500 {50...5000}	316 stainless steel 316 stainless steel 316 stainless steel	316L stainless steel Hast. C 316L stainless steel +Au coating	316 stainless steel SUS316 316 stainless steel																	36V
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	36W
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	36J
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	36H
			316 stainless steel Monel	Monel	Monel lining																	36M
			316 stainless steel Tantalum	Tantalum	Tantalum lining																	36T
		30...3000 {300...30000}	316 stainless steel 316 stainless steel	316L stainless steel 316L stainless steel +Au coating	316 stainless steel 316 stainless steel																	38V
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	38J
	-0.1 to +42 {−1 to +420}	0.32...32 {3.2...320}	316 stainless steel 316 stainless steel 316 stainless steel	316L stainless steel Hast. C 316L stainless steel +Au coating	316 stainless steel SUS316 316 stainless steel																	43V
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	43W
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	43J
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	43H
			316 stainless steel Monel	Monel	Monel lining																	43M
		1.3...130 {13...1300}	316 stainless steel 316 stainless steel 316 stainless steel	316L stainless steel Hast. C 316L stainless steel +Au coating	316 stainless steel SUS316 316 stainless steel																	45V
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	45W
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	45J
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	45H
			316 stainless steel Monel	Monel	Monel lining																	45M
		5...500 {50...5000}	316 stainless steel 316 stainless steel 316 stainless steel	316L stainless steel Hast. C 316L stainless steel +Au coating	316 stainless steel SUS316 316 stainless steel																	46V
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	46W
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	46J
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	46H
			316 stainless steel Monel	Monel	Monel lining																	46M
	-0.1 to +30 {−1 to +300}	30...3000 {300...30000}	316 stainless steel 316 stainless steel	316L stainless steel 316L stainless steel +Au coating	316 stainless steel 316 stainless steel																	48V
			316 stainless steel Hast. C	Hast. C	Hast. C lining																	48J
		500...20000 {5000...200000}	316 stainless steel	316L stainless steel	316 stainless steel																	49V
	-0.1 to +10 {−1 to +100}	0.32...32 {3.2...320}	Hast. C lining Monel lining Tantalum lining	Hast. C Monel Tantalum	Hast. C lining Monel lining Tantalum lining																	23B
			Hast. C lining Monel lining Tantalum lining	Hast. C Monel Tantalum	Hast. C lining Monel lining Tantalum lining																	23L
		1.3...130 {13...1300}	Hast. C lining Monel lining Tantalum lining	Hast. C Monel Tantalum	Hast. C lining Monel lining Tantalum lining																	23U
			Hast. C lining Monel lining Tantalum lining	Hast. C Monel Tantalum	Hast. C lining Monel lining Tantalum lining																	25B
			Hast. C lining Monel lining Tantalum lining	Hast. C Monel Tantalum	Hast. C lining Monel lining Tantalum lining																	25L
			Hast. C lining Monel lining Tantalum lining	Hast. C Monel Tantalum	Hast. C lining Monel lining Tantalum lining																	25U
		5...500 {50...5000}	Hast. C lining Monel lining Tantalum lining	Hast. C Monel Tantalum	Hast. C lining Monel lining Tantalum lining																	26B
			Hast. C lining Monel lining Tantalum lining	Hast. C Monel Tantalum	Hast. C lining Monel lining Tantalum lining																	26L
			Hast. C lining Monel lining Tantalum lining	Hast. C Monel Tantalum	Hast. C lining Monel lining Tantalum lining																	26U

Note 1: (\*1) The thread is M12, if 42MPa {420bar} static pressure is specified.

Note 2: (\*2) 100: 1 turn down is possible, but should be used at the span greater than 1/40 of the maximum span for better performance.

Digit	Description	Note	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	21	Digit No. of code
9	<Indicator and arrester>		F	K	C					5									
	<u>Indicator</u>	<u>Arrester</u>									A								
	None	None									B								
	Analog, 0 to 100% linear scale	None									C								
	Analog, 0 to 100% sq. root scale (*3)	None									D								
	Analog, custom scale	None									J								
	Analog, double scale (Linear and sq. root)	None									E								
	None	Yes									F								
	Analog, 0 to 100% linear scale	Yes									G								
	Analog, 0 to 100% sq. root scale (*3)	Yes									H								
	Analog, custom scale	Yes									K								
	Analog, double scale (Linear and sq. root)	Yes									L								
	Digital, 0 to 100% linear scale	None									P								
	Digital, custom scale	None									M								
	Digital 0 to 100% square root scale	None									Q								
	Digital, 0 to 100% linear scale	Yes									S								
	Digital, custom scale	Yes									N								
	Digital 0 to 100% square root scale	Yes									1								
	Digital, 0 to 100% linear scale	None									2								
	(Local configurator unit with LCD display)	None									3								
	Digital, custom scale	None									4								
	(Local configurator unit with LCD display)	None									5								
	Digital, 0 to 100% square root scale	Yes									6								
	(Local configurator unit with LCD display)	Yes																	
	Digital, custom scale	Yes																	
	(Local configurator unit with LCD display)	Yes																	
	Digital, 0 to 100% square root scale	Yes																	
	(Local configurator unit with LCD display)	Yes																	
10	<Approvals for hazardous locations>																		
	None (for ordinary locations)										A								
	TIIS, Flameproof (Conduit seal) (*12)	Note 12									B								
	TIIS, Flameproof (Cable gland seal) (*12)	Note 12									C								
	TIIS, Intrinsic safety										G								
	FM, Flameproof (or explosionproof) (*13)	Note 13									D								
	FM, Intrinsic safety and nonincentive										H								
	FM Combined of flameproof and intrinsic safety (*13)	Note 13									V								
	ATEX Flameproof (*14)	Note 14									X								
	ATEX Intrinsic safety										K								
	ATEX Type n										P								
	ATEX Combined of flameproof and intrinsic safety (*14)	Note 14									M								
	IECEx Scheme, Flameproof (*14)	Note 14									R								
	IECEx Scheme, Intrinsic safety										T								
	CSA, Flameproof (or explosionproof) (*15)	Note 15									E								
	CSA, Intrinsic safety and nonincentive										J								
	NEPSI, Flameproof (or explosionproof) (*13)	Note 13									F								
	NEPSI, Intrinsic safety (Entity)										S								
	NEPSI, Combined of flameproof and intrinsic safety (*13)	Note 13									U								
11	<Vent/ drain and mounting bracket>																		
	<u>Vent/drain</u>	<u>Mounting bracket</u>																	
	Standard	None																	
	Standard	Yes, SUS304																	
	Standard	Yes, SUS316																	
	Side	None																	
	Side	Yes, SUS304																	
	Side	Yes, SUS316																	
12	<Options>																		
	<u>Extra SS tag plate</u>	<u>Stainless steel elec. housing</u>																	
	None	None																	
	Yes	None																	
	None	None																	
	Yes	None																	
	None	Yes																	
	Yes	Yes																	
13	<Special applications and fill fluid>																		
	<u>Treatment</u>	<u>Fill fluid</u>																	
	Standard	Silicone oil																	
	Standard	Fluorinated oil																	
	<u>Degreasing</u>	<u>Silicone oil</u>																	
	Oxygen service	Fluorinated oil (7th digit code "V", "W", "J" only)																	
	Chlorine service	Fluorinated oil (7th digit code "H", "T", "B", "U")																	
	NACE specification	Silicone oil (Not available for 7th digit code "T", "U" and 15th digit code "A", "B")																	
	Vacuum service	Silicone oil for vacuum use																	
14	<Sensor O-ring / Gasket>																		
	Teflon (gasket)																		

Note 3: (\*3) In case of square root output mode, square root scale is not available.

Note 4: (\*4) Customer tag number can be engraved on standard stainless steel name plate. If extra tag plate is required, select "Yes".

Digit	Description	Note	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	21	Digit No. of code
15	<Bolt/nut> (*8)	Vent Drain plug type	F	K	C					5	-								
	Cr-Mo alloy hexagon socket head cap screw/carbon steel nut	Standard																	
	Cr-Mo alloy hexagon bolt/nut	Standard																	
	NACE bolt/nut (ASTM A193 B7M/A194 2HM) } (*5)	Standard																	
	NACE bolt/nut (ASTM A320 L7M/A194 2HM) }	Standard																	
	304 stainless steel bolt/304 stainless steel nut (*6)	Standard																	
	630 stainless steel bolt/304 stainless steel nut (*7)	Standard																	
	316 stainless steel bolt/316 stainless steel nut (*6)	Standard																	
21	<Other options> (*9)																		
	High accuracy type (*10)	Instruction manual attached																	
	Opposite Vent/Drain Plug Position	Instruction manual attached																	
	Instruction manual unattached																		
	Opposite Vent/Drain Plug Position	Instruction manual unattached																	

Note 5: (\*5) Static pressure should be -0.1 to +10MPa {-1 to +100bar}.

Note 6: (\*6) Available for 5th digit code "1", "2", "3". In case of stainless steel bolt with 5th digit code "3", static pressure should be -0.1 to +10MPa {-1 to + 100bar}.

Note 7: (\*7) Available for 5th digit code "3", "4".

Note 8: (\*8) In case of tropical use, select stainless bolts and nuts.

Note 9: (\*9) If other option is not necessary, 21st digit code is blank.

In case of 21st digit code is blank, instruction manual attached.

Note 10: (\*10) Available for 5th digit code "3", "4" and 6th digit code "3" to "8".

Note 11: (\*11) Not available for 10th digit code "B", "C".

Note 12: (\*12) Available for 4th digit code "5", "S".

Note 13: (\*13) Not available for 4th digit code "8", "W".

Note 14: (\*14) Available for 4th digit code "6", "8", "T", "W".

Note 15: (\*15) Available for 4th digit code "6", "T".

## ACCESSORIES

**Oval flanges:** (Model FFP, refer to Data Sheet No. EDS6-128)  
Converts process connection to 1/2-14 NPT or to Rc1/2; in carbon steel or in 316 stainless steel.

**Equalizing valves:** (Model FFN, refer to Data Sheet No. EDS6-128)  
Available in Carbon steel or in 316 stainless steel and in pressure rating 16MPa or 42MPa.

**Hand-held communicator:** (Model FXW, refer to Data Sheet No. EDS 8-47)

## ORDERING INFORMATION

When ordering this instrument, specify:

1. CODE SYMBOLS
2. Measuring range
3. Output orientation (burnout direction) when abnormality is occurred in the transmitter.  
Hold / Overscale / Underscale  
Unless otherwise specified, output hold function is supplied.
4. Output mode (linear or square root output)  
Unless otherwise specified, output mode is linear.
5. Indication method (indicated value and unit) in case of the actual scale (code D, H, P, S on 9th digit).
6. Tag No. (up to 14 alphanumeric characters), if required.


# OUTLINE DIAGRAM (Unit:mm)

< CODE SYMBOLS : FKC 

SW	T	X	V
----	---	---	---

VM	J	T	HW
----	---	---	----


 5 >

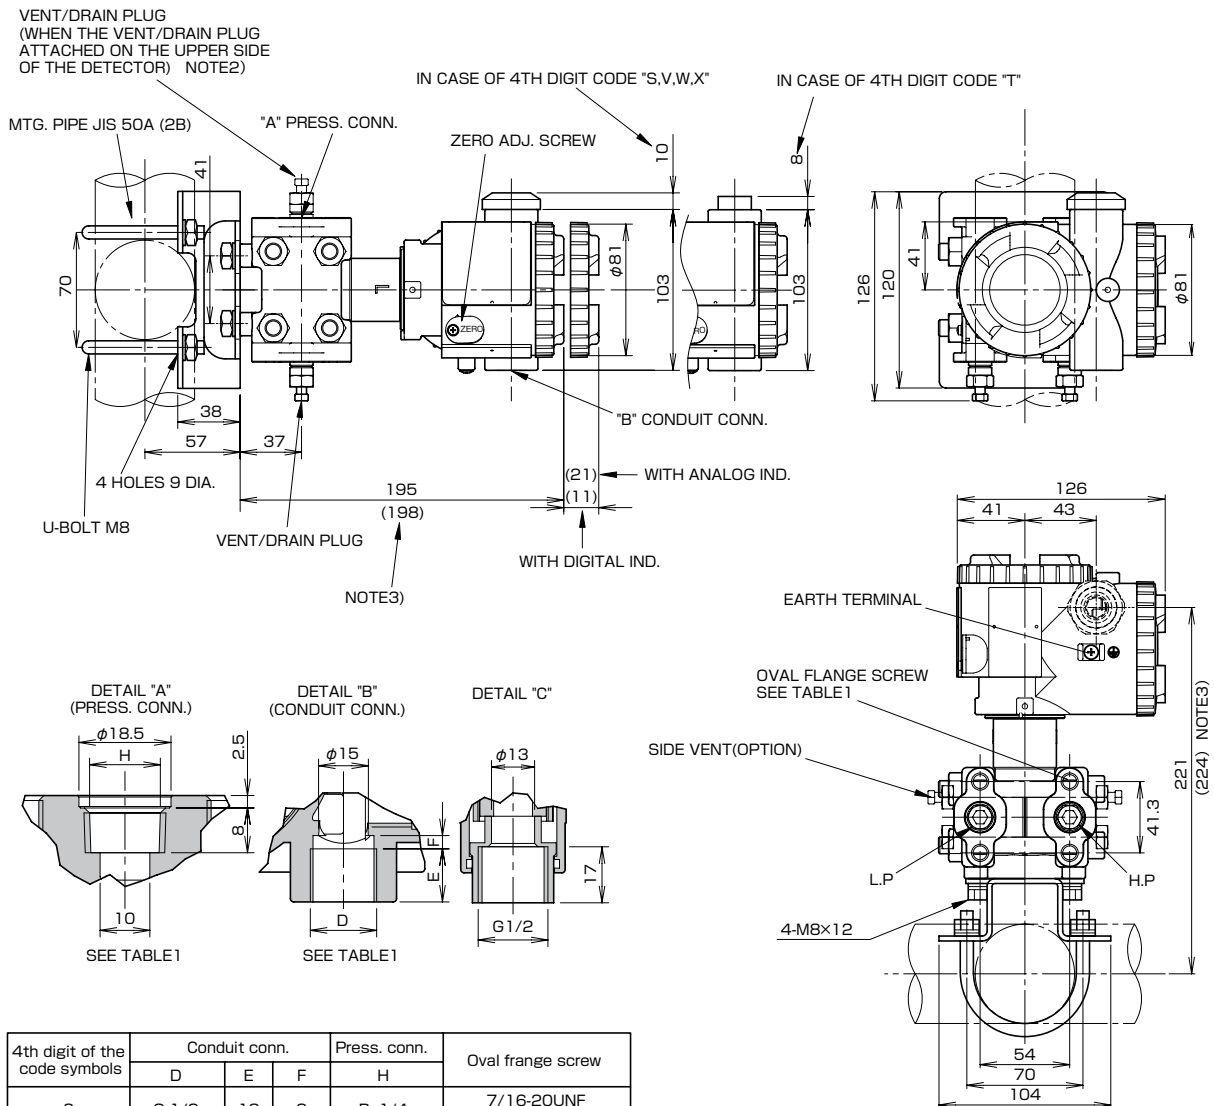

4th digit of the code symbols	Conduit conn.			Press. conn.	Oval frange screw
	D	E	F	H	
S	G 1/2	18	2	Rc1/4	7/16-20UNF SCREW DEPTH15
T	1/2-14NPT	16	4	1/4-18NPT	7/16-20UNF SCREW DEPTH15
V	Pg13.5	10.5	4.5	1/4-18NPT	M10 SCREW DEPTH15
W	M20x1.5	16	4	1/4-18NPT	M10 SCREW DEPTH15
X	Pg13.5	10.5	4.5	1/4-18NPT	7/16-20UNF SCREW DEPTH15

TABLE 1

## OPTION PARTS FOR FLAMEPROOF OF TIIS (JAPAN)

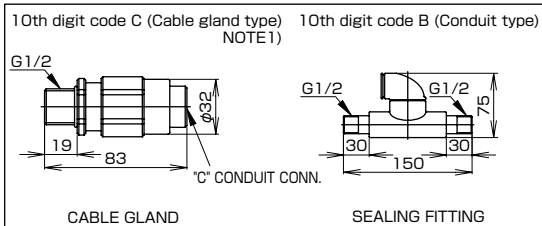

NOTE1) IN CASE OF 10TH CODE "C", φ11 CABLE IS SUITBLE.

NOTE2) THE PRESSURE CONNECTOR IS LOCATED ON THE DOWN SIDE SURFACE OF THE DETECTOR. WHEN THE VENT/DRAIN PLUG IS ATTACHED ON THE UPPER SIDE OF THE DETECTOR (WHEN THE 21ST DIGIT OF THE CODE SYMBOLS : C, P).

NOTE3) WHEN THE 5TH DIGIT OF THE CODE SYMBOLS "1,2,4" OR THE 7TH DIGIT OF THE CODE SYMBOLS "C,H,M,T"




< CODE SYMBOLS : FKC

5 8  
6 9  
7

VM  
JT  
HW


5 >

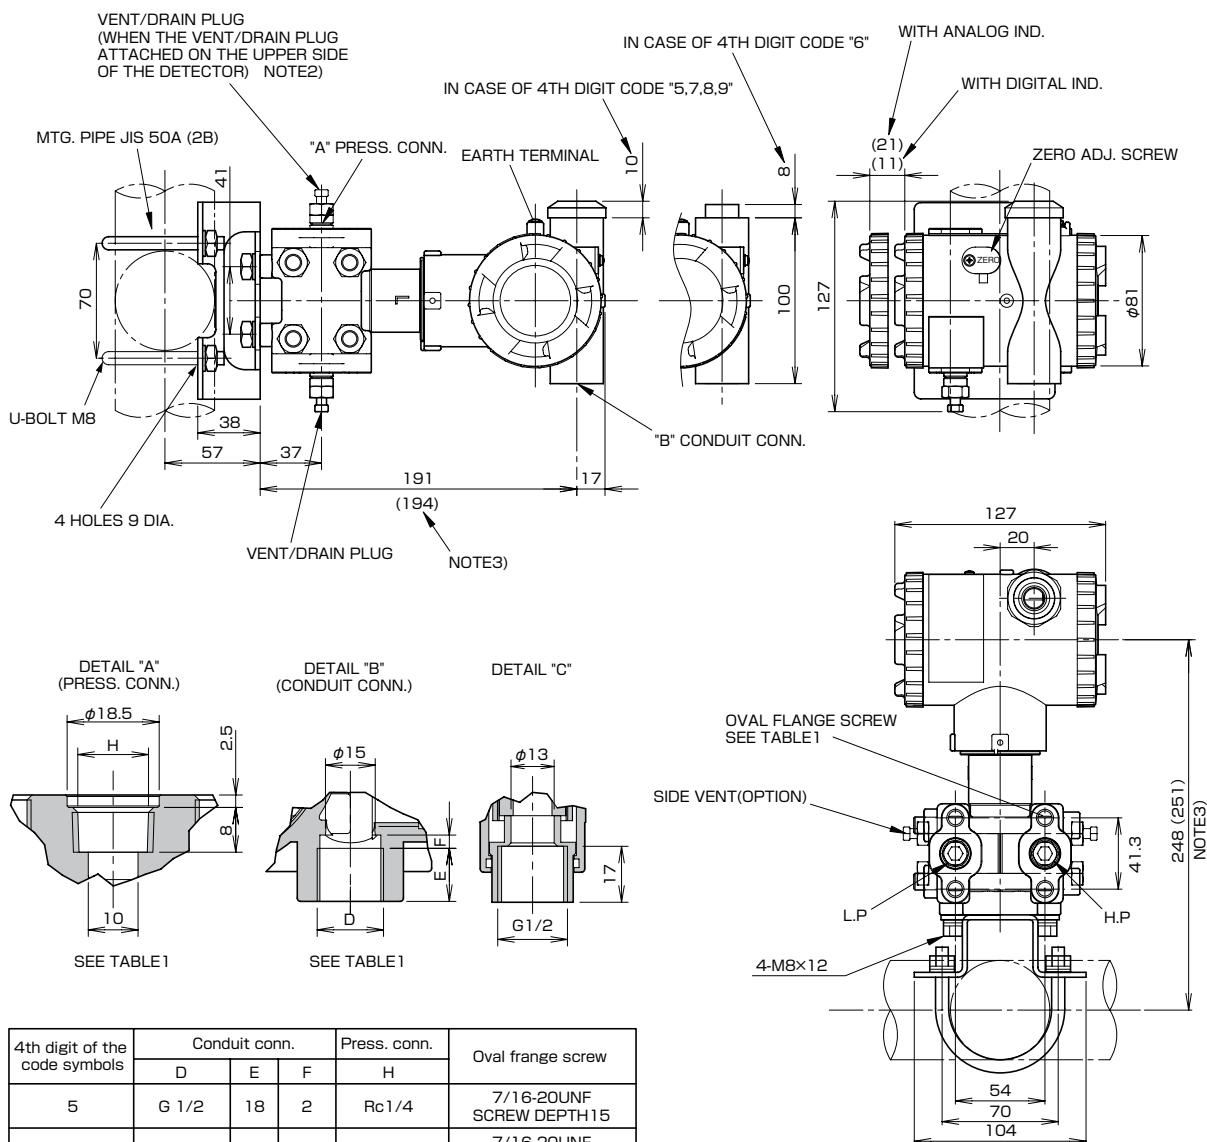


4th digit of the code symbols	Conduit conn.			Press. conn.	Oval frange screw
	D	E	F	H	
5	G 1/2	18	2	Rc1/4	7/16-20UNF SCREW DEPTH15
6	1/2-14NPT	16	4	1/4-18NPT	7/16-20UNF SCREW DEPTH15
7	Pg13.5	10.5	4.5	1/4-18NPT	M10 SCREW DEPTH15
8	M20x1.5	16	4	1/4-18NPT	M10 SCREW DEPTH15
9	Pg13.5	10.5	4.5	1/4-18NPT	7/16-20UNF SCREW DEPTH15

TABLE 1

# CONNECTION DIAGRAM



## OPTION PARTS FOR FLAMEPROOF OF TIIS (JAPAN)

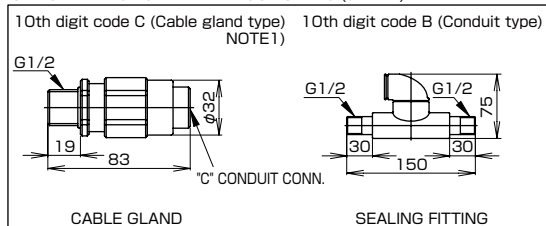


NOTE1) IN CASE OF 10TH CODE "C",  $\phi 11$  CABLE IS SUITBLE.

NOTE2) THE PRESSURE CONNECTOR IS LOCATED ON THE DOWN SIDE SURFACE OF THE DETECTOR, WHEN THE VENT/DRAIN PLUG IS ATTACHED ON THE UPPER SIDE OF THE DETECTOR (WHEN THE 21ST DIGIT OF THE CODE SYMBOLS : C, P).

NOTE3) WHEN THE 5TH DIGIT OF THE CODE SYMBOLS "1,2,4" or THE 7TH DIGIT OF THE CODE SYMBOLS "C,H,M,T"



< CODE SYMBOLS : FKCSW TX V □ □ B U 5 >

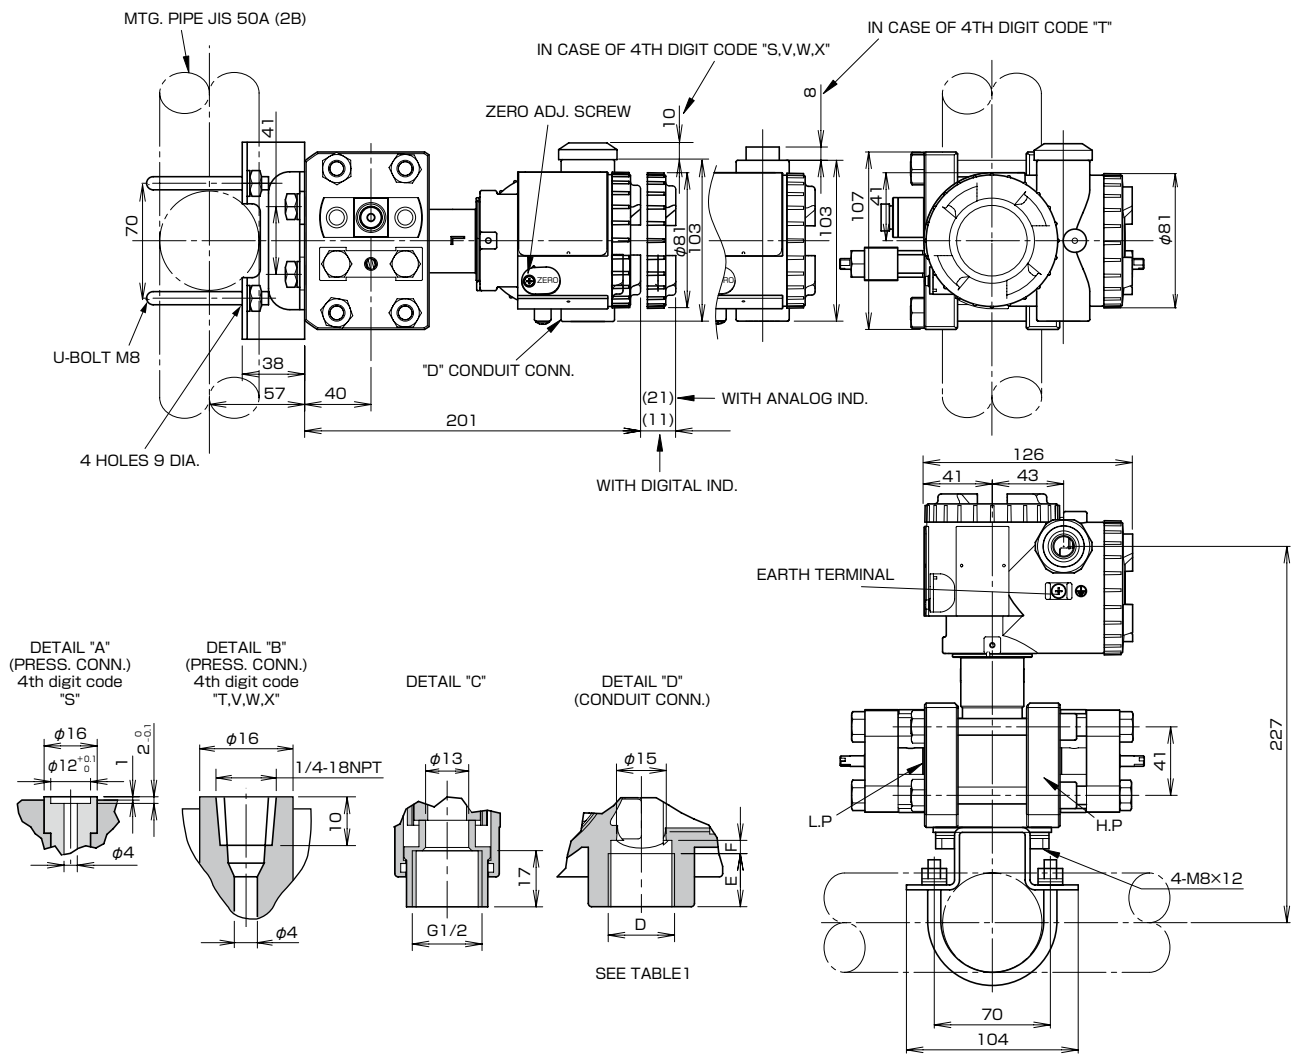

4th digit of the code symbols	Conduit conn.			Oval frange screw
	D	E	F	
S	G 1/2	18	2	7/16-20UNF SCREW DEPTH15
T	1/2-14NPT	16	4	7/16-20UNF SCREW DEPTH15
V	Pg13.5	10.5	4.5	M10 SCREW DEPTH15
W	M20×1.5	16	4	M10 SCREW DEPTH15
X	Pg13.5	10.5	4.5	7/16-20UNF SCREW DEPTH15


TABLE 1

## CONNECTION DIAGRAM

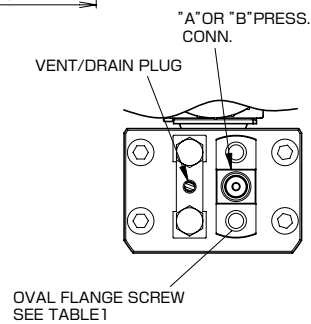

### OPTION PARTS FOR FLAMEPROOF OF TIIS (JAPAN)

10th digit code C (Cable gland type) NOTE1)	10th digit code B (Conduit type)
--	----------------------------------

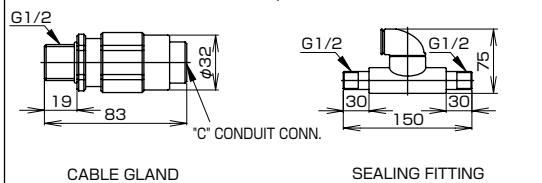


NOTE1) IN CASE OF 10TH CODE "C",  $\phi 11$  CABLE IS SUITBLE.

< CODE SYMBOLS : FK 


5	8
6	9
7	


B
U
L

 5 >

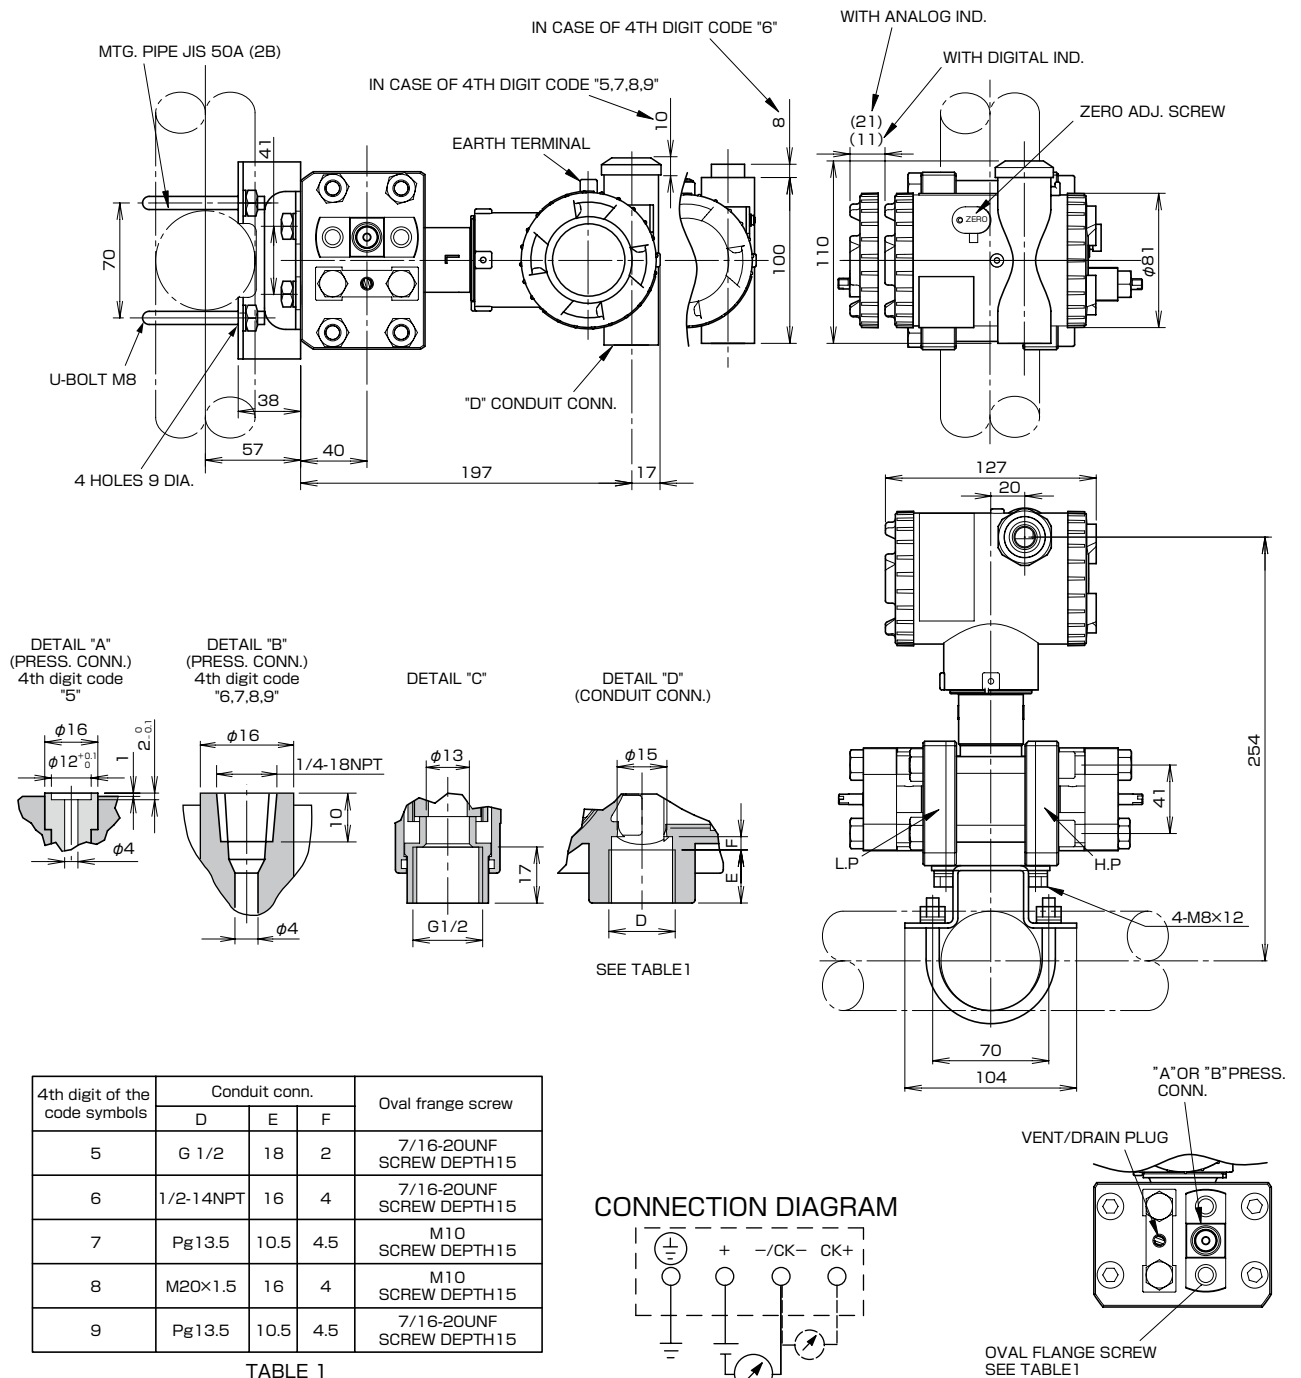

OPTION PARTS FOR FLAMEPROOF OF TIIS (JAPAN)

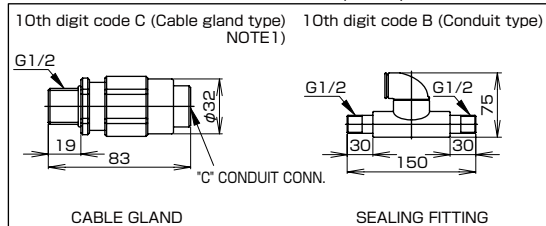

NOTE1) IN CASE OF 10TH CODE "C",  $\phi 11$  CABLE IS SUITBLE.

TABLE 2

Authorities	Intrinsic safety																				
ATEX	Ex II 1 G Ex ia IIC T5 Tamb = -40°C to +50°C Ex ia IIC T4 Tamb = -40°C to +70°C  Entity Parameters: Ui=28V, Ii=94.3mA, Pi=0.66W, Ci=26nF (Without Arrester), Li=0.6mH (Without analog indicator), Ci=36nF (With Arrester), Li=0.7mH (With analog indicator)																				
Factory Mutual (pending)	Class I II III Div.1 Groups A, B, C, D, E, F, G T4 Entity Type 4X <table><tr><th colspan="2">Model code</th><th rowspan="2">Tamb</th></tr><tr><th>9th digit</th><th>13th digit</th></tr><tr><td>A,B,C,D,J</td><td>Y,G,N,R</td><td>-40°C to +85°C</td></tr><tr><td>L,P,M,1,2,3</td><td>Y,G,N,R</td><td>-20°C to +80°C</td></tr><tr><td>Q,S,N,4,5,6</td><td>Y,G,N,R</td><td>-20°C to +60°C</td></tr><tr><td>E,F,G,H,K</td><td>Y,G,N,R</td><td>-40°C to +60°C</td></tr><tr><td>-</td><td>W,A,D</td><td>-10°C to +60°C</td></tr></table> Entity Parameters: Vmax=42.4V, Imax=113mA, Pi=1W, Ci=35.98nF, Li=0.694mH	Model code		Tamb	9th digit	13th digit	A,B,C,D,J	Y,G,N,R	-40°C to +85°C	L,P,M,1,2,3	Y,G,N,R	-20°C to +80°C	Q,S,N,4,5,6	Y,G,N,R	-20°C to +60°C	E,F,G,H,K	Y,G,N,R	-40°C to +60°C	-	W,A,D	-10°C to +60°C
Model code		Tamb																			
9th digit	13th digit																				
A,B,C,D,J	Y,G,N,R	-40°C to +85°C																			
L,P,M,1,2,3	Y,G,N,R	-20°C to +80°C																			
Q,S,N,4,5,6	Y,G,N,R	-20°C to +60°C																			
E,F,G,H,K	Y,G,N,R	-40°C to +60°C																			
-	W,A,D	-10°C to +60°C																			
CSA	Class I Div.1 Groups A, B, C, D Class II Div.1 Groups E, F, G Class III Div.1 Temp Code T5 Tamb max = +50°C Temp Code T4 Tamb max = +70°C Entity Parameters: Vmax=28V, Imax=94.3mA, Ci=25nF (Without Arrester), Ci=36nF (With Arrester), Li=0.6mH (Without analog meter), Li=0.7mH (With analog meter)																				
TIIS	Ex ia IIC T4 Tamb max = +60°C Entity Parameters: Ui=28V, Ii=94.3mA, Pi=0.66W, Ci=38.4nF, Li=0.694mH																				
IECEx Scheme	Ex ia IIC T4 Tamb = -40°C to +70°C Ex ia IIC T5 Tamb = -40°C to +50°C Entity Parameters: Ui=28V, Ii=94.3mA, Pi=0.66W, Ci=26nF (Without Arrester), Li=0.6mH (Without analog indicator), Ci=36nF (With Arrester), Li=0.7mH (With analog indicator)																				
NEPSI	Ex ia IIC T4 Ex d IIB+H2 T6 / Ex ia IIC T4 <table><tr><th colspan="2">Model code</th><th rowspan="2">Tamb</th></tr><tr><th>9th digit</th><th>13th digit</th></tr><tr><td>A,B,C,D,J</td><td>Y,G,N,R</td><td>-40°C to +85°C</td></tr><tr><td>L,P,M,1,2,3</td><td>Y,G,N,R</td><td>-20°C to +80°C</td></tr><tr><td>Q,S,N,4,5,6</td><td>Y,G,N,R</td><td>-20°C to +60°C</td></tr><tr><td>E,F,G,H,K</td><td>Y,G,N,R</td><td>-40°C to +60°C</td></tr><tr><td>-</td><td>W,A,D</td><td>-10°C to +60°C</td></tr></table> Entity Parameters: Ui=42.4V, Ii=113mA, Pi=1W, Ci=35.98nF, Li=0.694mH	Model code		Tamb	9th digit	13th digit	A,B,C,D,J	Y,G,N,R	-40°C to +85°C	L,P,M,1,2,3	Y,G,N,R	-20°C to +80°C	Q,S,N,4,5,6	Y,G,N,R	-20°C to +60°C	E,F,G,H,K	Y,G,N,R	-40°C to +60°C	-	W,A,D	-10°C to +60°C
Model code		Tamb																			
9th digit	13th digit																				
A,B,C,D,J	Y,G,N,R	-40°C to +85°C																			
L,P,M,1,2,3	Y,G,N,R	-20°C to +80°C																			
Q,S,N,4,5,6	Y,G,N,R	-20°C to +60°C																			
E,F,G,H,K	Y,G,N,R	-40°C to +60°C																			
-	W,A,D	-10°C to +60°C																			

Authorities	Flameproof																				
ATEX	Ex II 2 GD Ex d IIC T6 IP66/67 T85°C Tamb = -40°C to +65°C Ex d IIC T5 IP66/67 T100°C Tamb = -40°C to +85°C																				
Factory Mutual	Class I Div.1 Groups B, C, D T6 Type 4X Class II III Div.1 Groups E, F, G T6 Type 4X Tamb max = +60°C																				
CSA	Class I Div.1 Groups C, D Class II Div.1 Groups E, F, G Class III Div.1  Note) "Seal Not Required" enclosure is allowed.																				
TIIS	Ex do IIB+H <sub>2</sub> T4 Tamb max = +60°C Maximum process temp. = +120°C																				
IECEx Scheme	Ex d IIC T5 IP66/67 Tamb = -40°C to +85°C Ex d IIC T6 IP66/67 Tamb = -40°C to +65°C																				
NEPSI	Ex d IIB+H <sub>2</sub> T6 Tamb = -40°C to +60°C																				
Authorities	Type n Nonincendive																				
ATEX	Ex II 3 GD EEx nL IIC T5 Tamb = -40°C to +50°C EEx nL IIC T4 Tamb = -40°C to +70°C Specific Parameters: Model without arrester: Ui=42.4V, li=113mA, Pi=1W, Ci=25.18nF, Li=0.694mH Model with arrester: Ui=32V, li=113mA, Pi=1W, Ci=35.98nF, Li=0.694mH  EEx nAL IIC T5 Tamb = -40°C to +50°C EEx nAL IIC T4 Tamb = -40°C to +70°C Specific Parameters: Model without arrester: Umax=42.4V, lmax=113mA, Pmax=1W Model with arrester: Umax=32V, lmax=113mA, Pmax=1W																				
Factory Mutual (pending)	Class I II III Div.2 Groups A, B, C, D, F, G T4 Entity Type 4X <table><tr><th colspan="2">Model code</th><th rowspan="2">Tamb</th></tr><tr><th>9th digit</th><th>13th digit</th></tr><tr><td>A,B,C,D,J</td><td>Y,G,N,R</td><td>-40°C to +85°C</td></tr><tr><td>L,P,M,1,2,3</td><td>Y,G,N,R</td><td>-20°C to +80°C</td></tr><tr><td>Q,S,N,4,5,6</td><td>Y,G,N,R</td><td>-20°C to +60°C</td></tr><tr><td>E,F,G,H,K</td><td>Y,G,N,R</td><td>-40°C to +60°C</td></tr><tr><td>-</td><td>W,A,D</td><td>-10°C to +60°C</td></tr></table>	Model code		Tamb	9th digit	13th digit	A,B,C,D,J	Y,G,N,R	-40°C to +85°C	L,P,M,1,2,3	Y,G,N,R	-20°C to +80°C	Q,S,N,4,5,6	Y,G,N,R	-20°C to +60°C	E,F,G,H,K	Y,G,N,R	-40°C to +60°C	-	W,A,D	-10°C to +60°C
Model code		Tamb																			
9th digit	13th digit																				
A,B,C,D,J	Y,G,N,R	-40°C to +85°C																			
L,P,M,1,2,3	Y,G,N,R	-20°C to +80°C																			
Q,S,N,4,5,6	Y,G,N,R	-20°C to +60°C																			
E,F,G,H,K	Y,G,N,R	-40°C to +60°C																			
-	W,A,D	-10°C to +60°C																			
CSA	Class I Div.2 Groups A, B, C, D Class II Div.2 Groups E, F, G Class III Div.2 Temp Code T5 Tamb max = +50°C Temp Code T4 Tamb max = +70°C Entity Parameters: Vmax=28V, Ci=25.18nF (Without Arrester), Ci=35.98nF (With Arrester), Li=0.694mH																				

### ⚠ Caution on Safety

\*Before using this product, be sure to read its instruction manual in advance.

## Fuji Electric Systems Co., Ltd.

### International Sales Div.1

#### Sales Group

Gate City Ohsaki, East Tower, 11-2, Osaki 1-chome,  
Shinagawa-ku, Tokyo 141-0032, Japan

<http://www.fesys.co.jp/eng>

Phone: 81-3-5435-7280, 7281 Fax: 81-3-5435-7425

<http://www.fic-net.jp/eng>